

REMOTE FDC BOLLARD DETAIL




REMOTE FIRE DEPARTMENT CONNECTION NOTES:

1. Clear space of 3 ft. shall be maintain around the fire hydrant. Building elements, signs, trees, bushes, shrubberies, or other landscaping shall not be located within the 3 ft. clear space or in front of the Remote FDC and bollards.
2. FDC shall be between 36 in. and 48 in. above grade.
 - 2.1 Barrell shall be painted traffic red and be provided with a 2-inch, white, 3M diamond-grade reflective tape stripe around the upper half of the barrel.
3. Bollards shall be constructed in accordance with IFC Section 312 and as follows:
 - 3.1. Spaced 3 ft. from the face of the Remote FDC.
 - 3.2. Set not less than 3 ft. deep in a concrete footing of not less than 15 in. diameter.
 - 3.3. Top of the post shall not be less than 3 ft. above grade.
 - 3.4. Spaced not more than 4 ft. between posts.
 - 3.5. Constructed of steel not less than 4 in. diameter and concrete filled.


SIGNAGE NOTES:

1. Sign shall be directly behind the Remote FDC.
2. Shall be mounted on a sign post that extends a minimum 6 ft. above grade.
3. Numerical building number/address shall be displayed on the sign.
4. Sign face shall be traffic red. Lettering shall be white and reflective.
5. Shall be identified in accordance with the PFR-FMO Sign Specification Guide.

ELEVATION VIEW

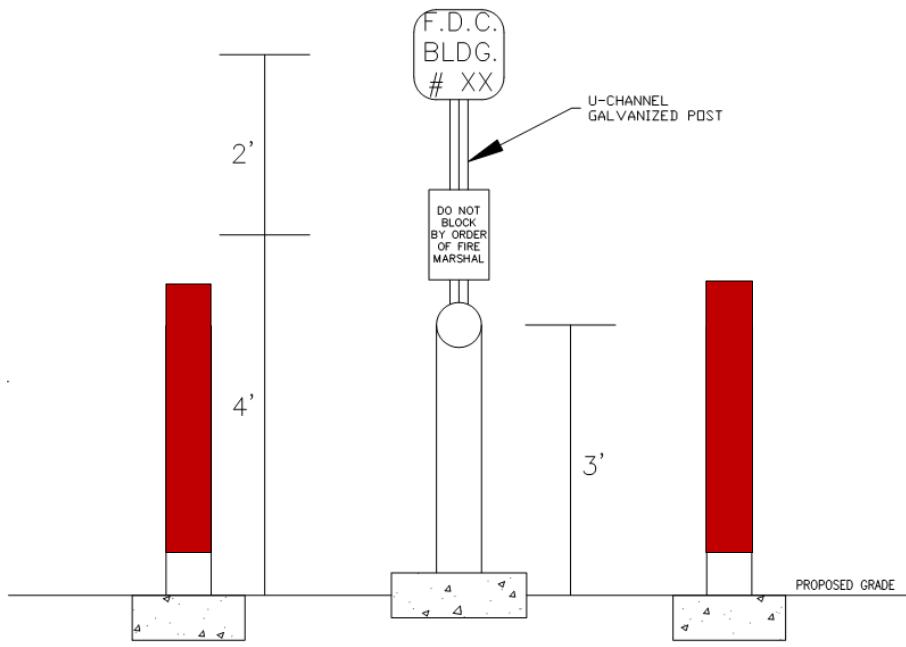

PLAN VIEW

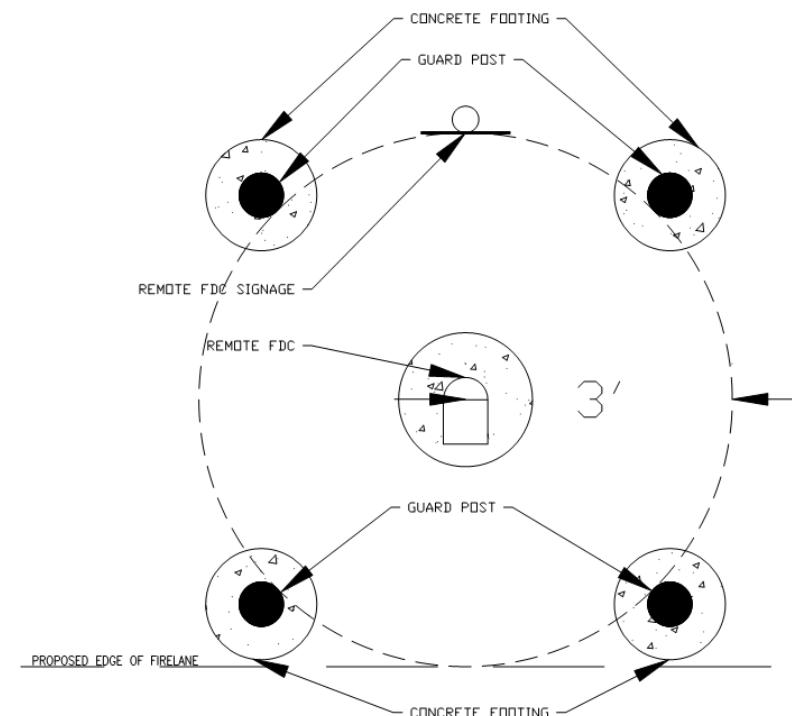

PROSPER FIRE RESCUE
FIRE MARSHAL'S OFFICE

DRAWN

ANDREW BARR, CFPS

ISSUED

May 2023

SIZE	FSCM NO	DWG NO		REV
8.5X11		REMOTE FDC BOLLARD DETAIL		1
SCALE	1 : 1			
		SHEET	1 OF 1	