

WAYFARING SIGN GUIDE




IFC SECTION 505.3

A wayfaring sign shall be provided for all new and existing multi-building developments in which multiple buildings are addressed off a single address, such as in an apartment complex, or when the nature and arrangement of the buildings, such signage would be conducive to navigation. Such signs shall be placed at all points of entry into the development, or as required by the *Fire code official*.

Minimum Requirements

1. Provide a simplified layout of the development.
2. Indicate all entry and exit points.
3. Minimum 36 inch by 36 inch.
4. Shall be provided with lighting and/or wholly reflective.
5. Permanently mounted and visible to the entry and exit.
6. Indicate major buildings and building numbers.
7. Indicate the name, address and phone number.
8. Shall be constructed of outdoor, weather-resistant material.

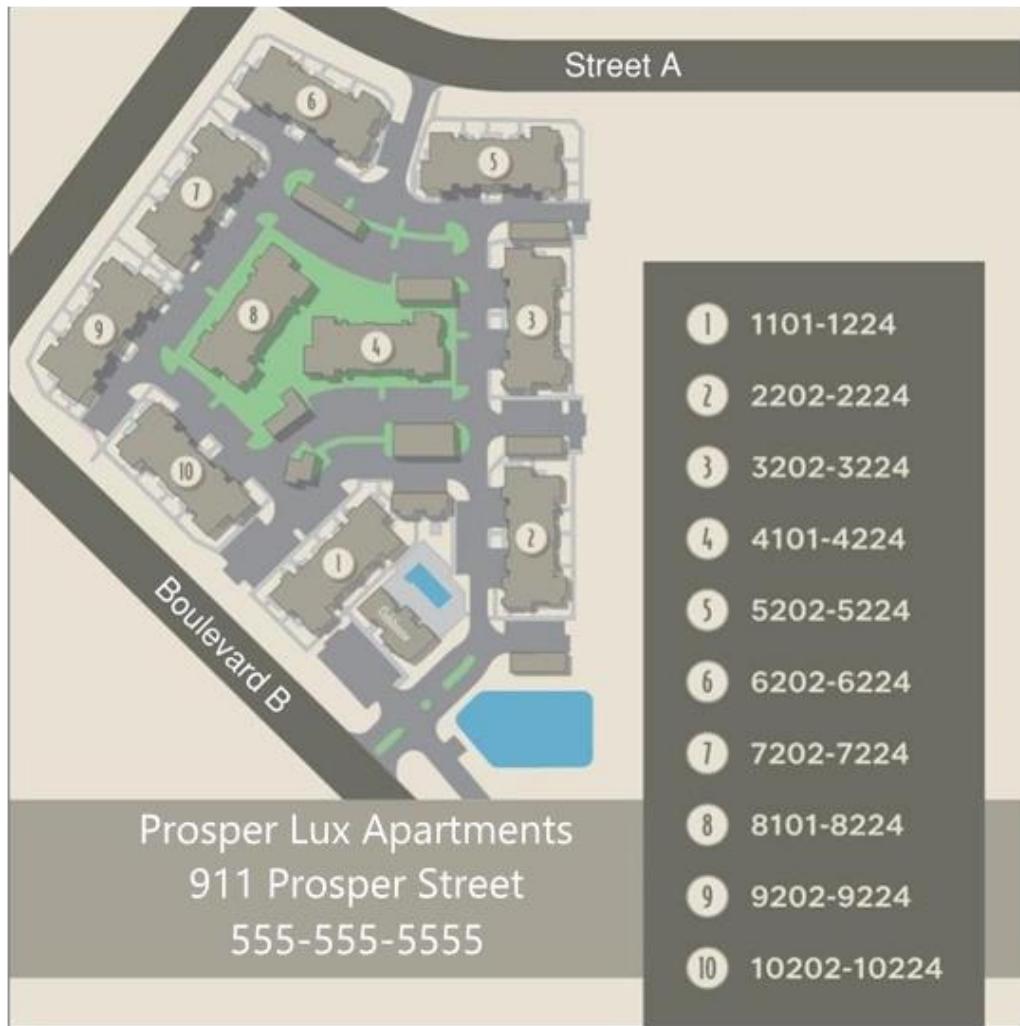

PROSPER FIRE RESCUE FIRE MARSHAL'S OFFICE		SIZE	FSCM NO	DWG NO	REV
DRAWN	ANDREW BARR, CFPS	8.5X11		WAYFARING	1
ISSUED	APRIL 2023	SCALE	1 : 1		SHEET 1 OF 1